



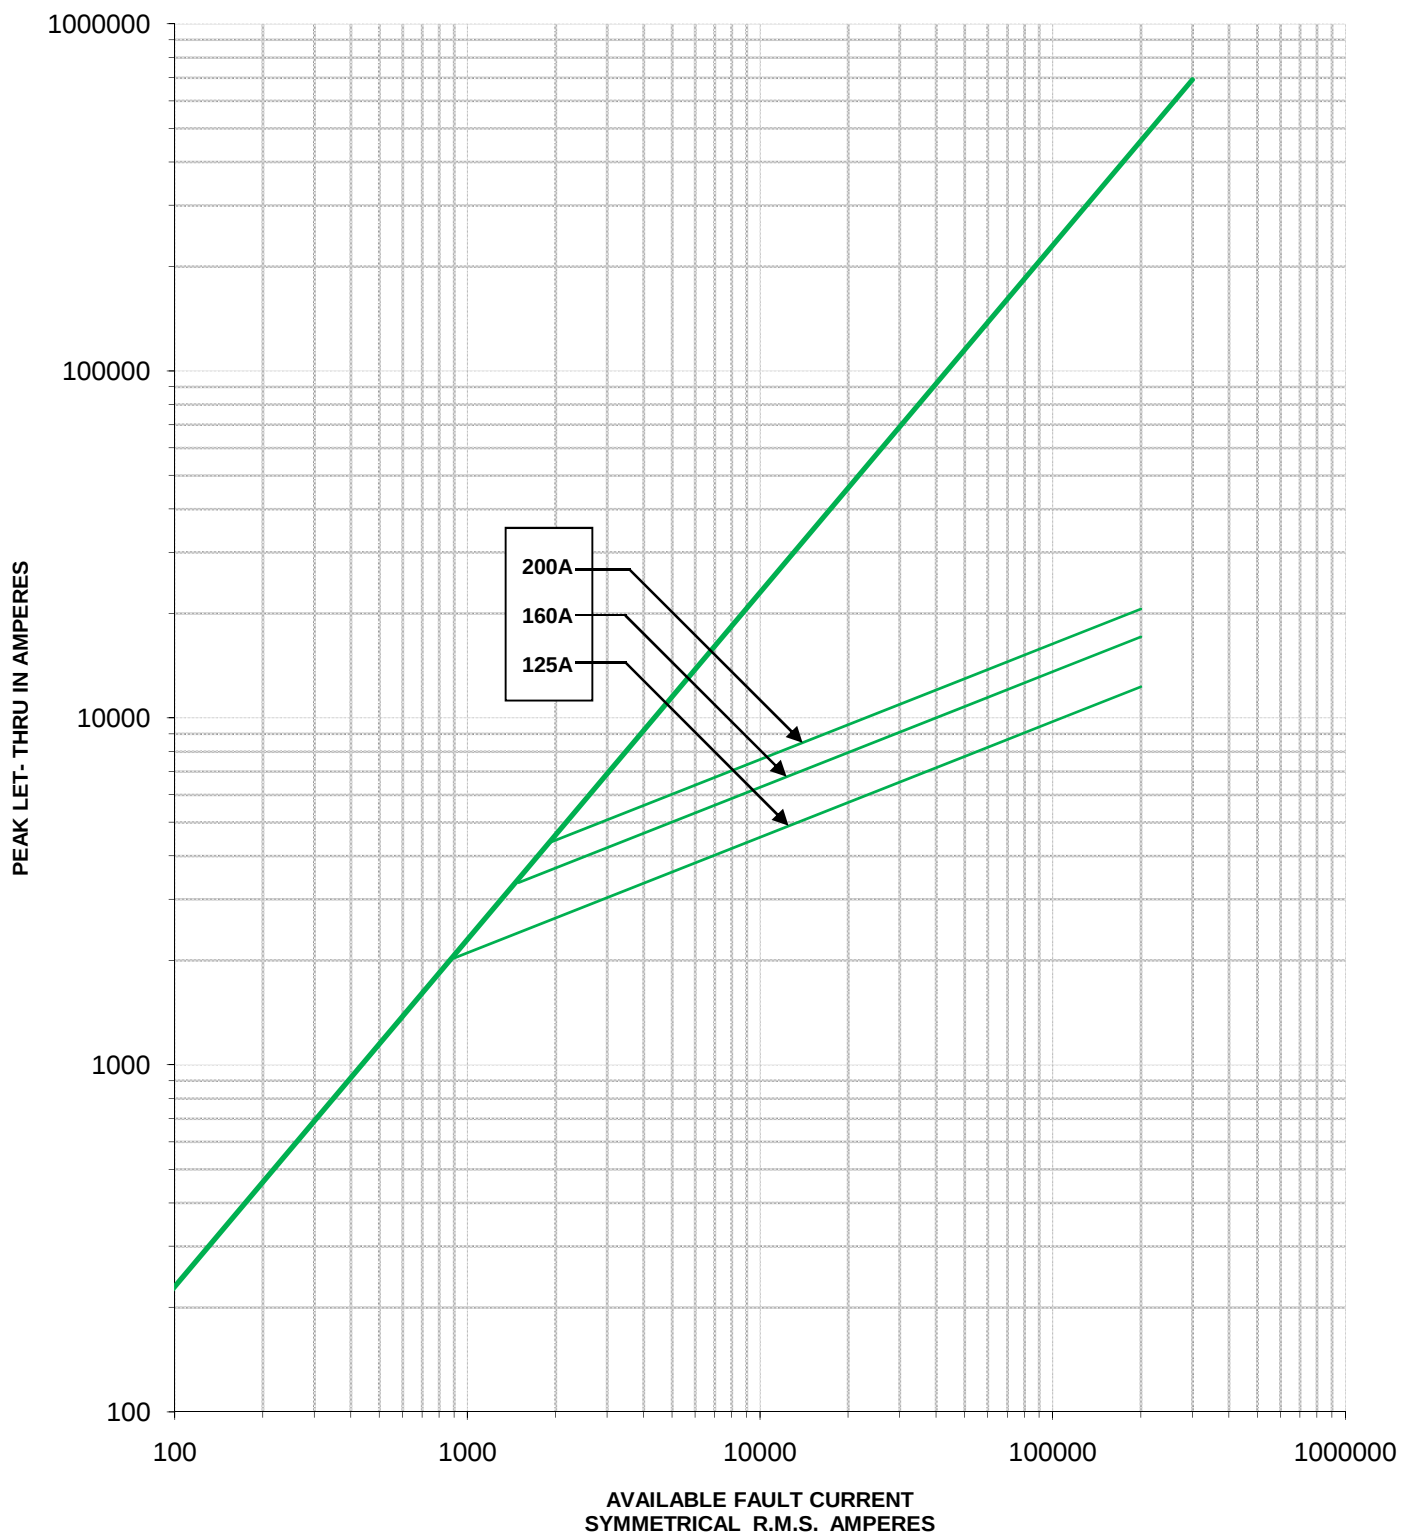

TEST VOLTAGE: 600 Vac		TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER SPFJ 125A-450A
BASIS FOR DATA:			
 LITTELFUSE, INC. CHICAGO, IL USA			DRAWN BY: NCS DATE: 4/27/2011 REVISION : A
PEAK LET-THRU CHARACTERISTIC CURVES			DRAWING NO. Sheet 2 of 3 FCC05-SPFJ

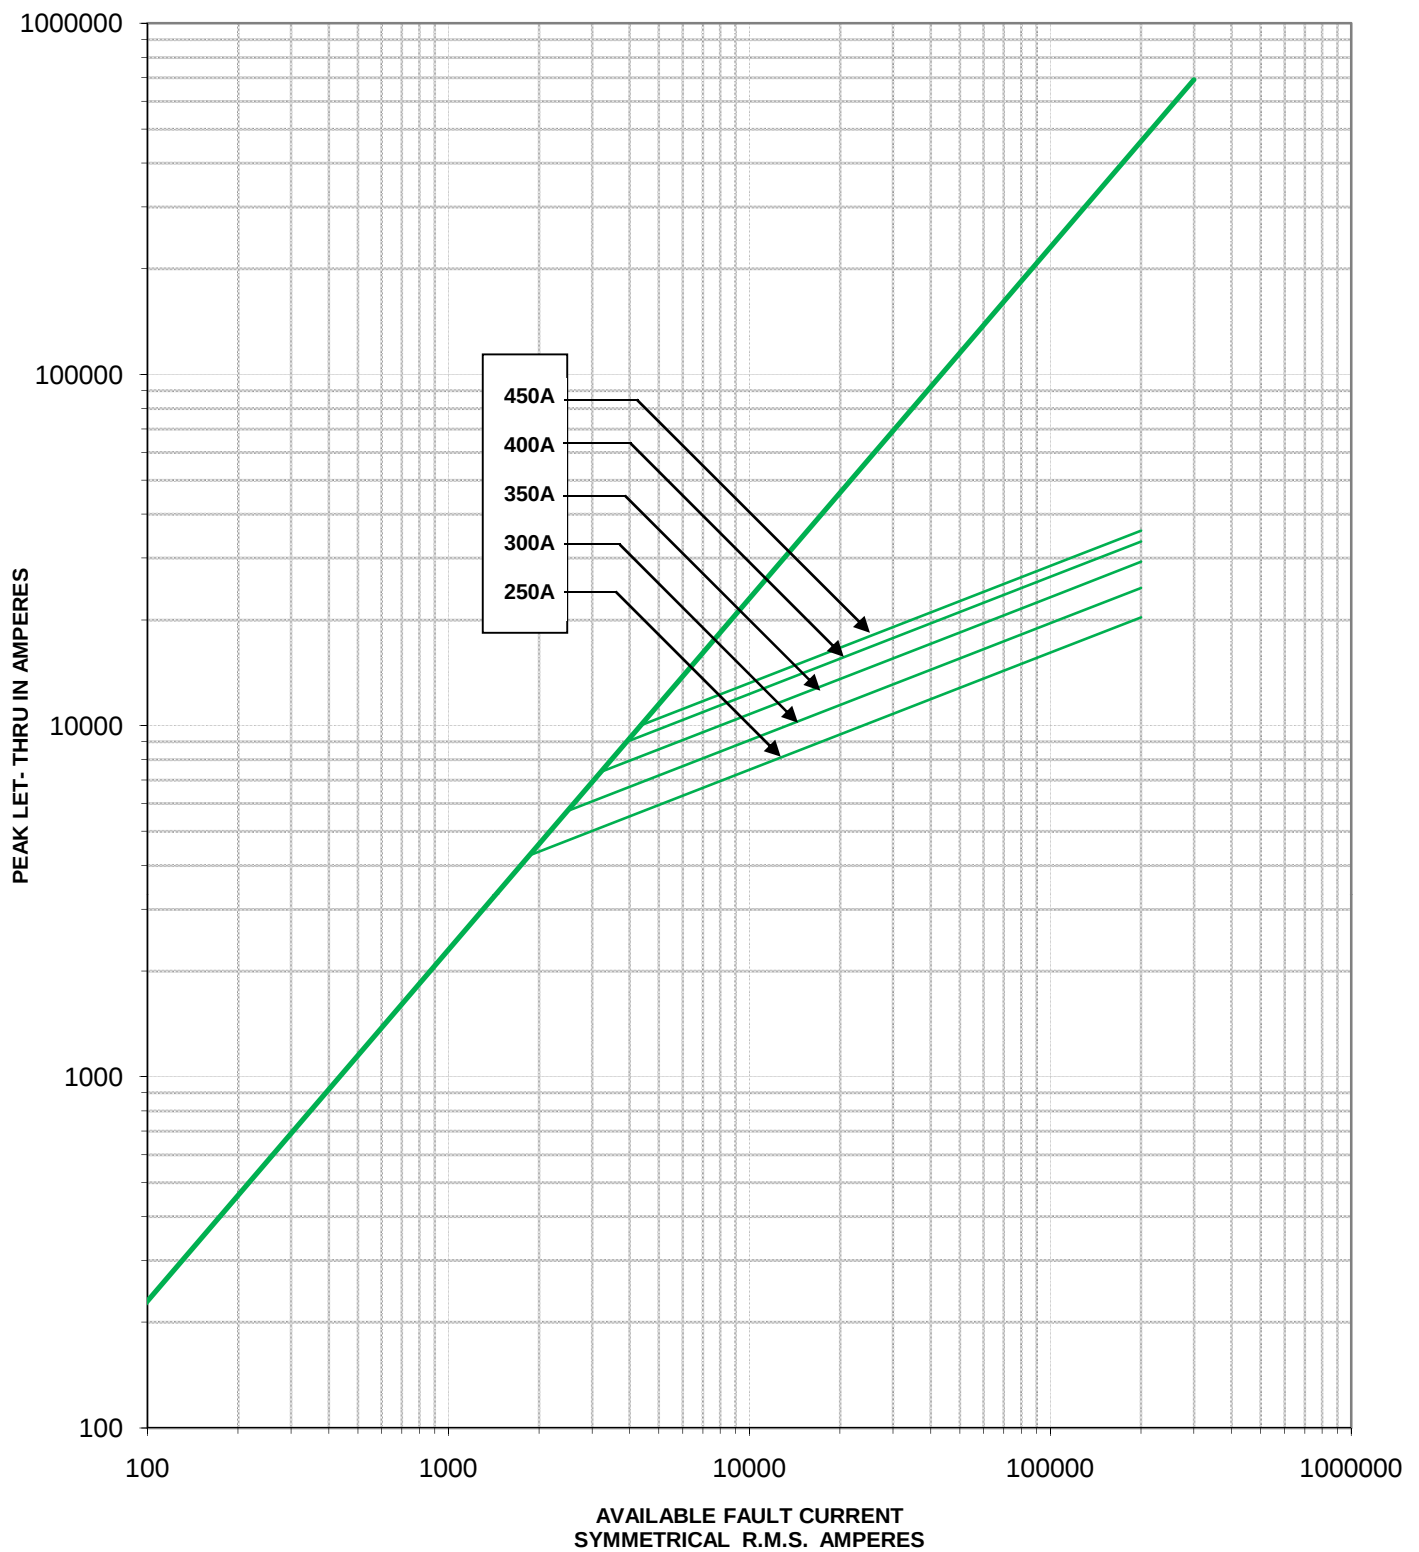

TEST VOLTAGE: 600 Vac		TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER SPFJ 125A-450A
BASIS FOR DATA:			
		LITTELFUSE, INC. CHICAGO, IL USA	DRAWN BY: NCS DATE: 4/27/2011 REVISION : A
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO. Sheet 3 of 3 FCC05-SPFJ	

THIS DATA GENERATED BY EVAPOR